



西安电力高等专科学校  
XI'AN ELECTRIC POWER COLLEGE

2020

---

---

---

---

---



---



---






“

”

2

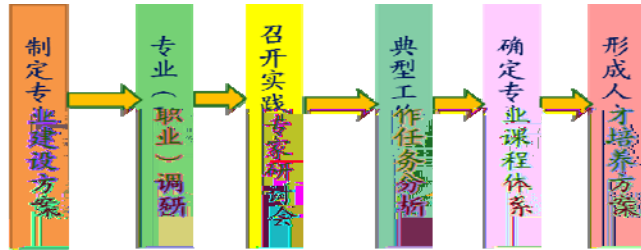

2

1

”

“

2

3

4

14

5







---

560303

56	560303	44	6 28 99		



- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 2
- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 3
- 1
- 2
- 3

;

PLC DCS

DCS PLC

SAMA

---

4  
5  
6  
7  
AutoCAD  
8  
9  
10  
11  
PLC  
12

DCS

1			
			1
			2 3

			4
2			
			1. 2 3
3	1-2		
			1. 2 3
4	1-2		
			1. 2 3
5	1-4		1.      2 3

			1. 2 3
6	1-2		1800
			1. AB 2 3
7			
			1. 2 3

---

			Windows Office Internet

8

1.

2

3



			1. 2. 3.
12			
			1. 2. 3.
13			
			” “
14			8


1

15	CAD		CAD CAD
			1. 2. 3. CAD
16			
			1. 2. 3. 4.

17			
			1. 2. 3. 4. 5. 6.
18			1. 2. DCS 3.
			1. 2. 3. 4.
19			1. 2. 3. 4.
			1.

			2
20			
			1. 2 3
21			
			1. 2 3 4
22			

			<ol style="list-style-type: none"> <li>1.</li> <li>2</li> <li>3</li> <li>4</li> <li>5</li> </ol> <p style="text-align: center;">MILAB</p>

2

23			<ol style="list-style-type: none"> <li>1.</li> <li>2</li> <li>3</li> <li>4</li> </ol>
24			<ol style="list-style-type: none"> <li>1.</li> <li>2</li> <li>3</li> </ol>

			4 5 6 7
25			1. 2 3 4
			1. 2 3 4 5 6
26			TSI
			1. TSI 2. TSI 3. TSI 4. TSI 5. DEH

			6 BPC 7.
27	PLC		PLC PLC
			1. 2 3 4 PLC I/O 5 6 7. 8
28			
			1. 2 3 4
29			

			1. 2 3 4 5 6
30			1. 2 3 4
			1. <span style="float: right;">SAMA</span> 2 3
31			MFT EIS FSSS
			1. 2 3 4 5



32			1. DCS  DCS  2 DCS
			1.  2 DCS 3 “ ”

3

33			1.  2
			1  2 3 4
34			Modbus-RIU Prof bus-DP
			1. profibus FF  2 Modbus 3 PLC
35			
			1.

			2
36			1. 2 ; 3 ; 4 5 6
			1.  2 3
37			
			1.  2  3

4

38			
			1.  2

			3 4 5 6 7.
39			1. 2 3 4 5 6 7. 8

40			<p>DCS PLC</p> <p>MCS DEH FSSS</p> <p>DCS</p> <p>,</p> <p>,</p>
			<p>1. DCS PLC</p> <p>2</p> <p>3</p> <p>4</p> <p>5</p>
41			


1. 2  
 56 36  
 2 1 28  
 3 5 8  
40  
 4 17  
 5  
 6  
 7. 16 4 2

										(15+3 W)	(15+4 W)	(19+0 W)	(16+3 W)	(18+1 W)	(0+17 W)	
1			0221231		1	KC	28	0	28	1W						1.6
2			0521018		1	KC	36	56	92	2W/36						5.1
3			0601033	1	1	KS	20	4	24	1*2*12						1.3
4			0601034	2	2	KS	26	4	30		1*2*15					1.7
5			0601035	1	2	KS	32	4	36		1*3*12					2.0
6			0601036	2	3	KS	30	6	36			1*3*12				2.0
7			0501040	1	1	KC		28	28	1*2*14						1.6
8			0501041	2	2	KC		28	28		1*2*14					1.6
9			0501042	3	3	KC		28	28			1*2*14				1.6
10			0501043	4	4	KC		28	28				1*2*14			1.6
11			0501037	1	1	KS	52	4	56	2*2*14						3.1
12			0501038	2	2	KS	52	4	56		2*2*14					3.1
13			0501039		1	KS	50		50	2*2*13						2.8
14			0421100		2	KS	24	24	48		1*4*12/A					2.7
15			0601037		1	KC	30		30	1*2*15						1.7
16			0601051- 54	1- 4	2- 5	KC	16		16		A/2*2	A/2*2	A/2*2	A/2*2		0.9
17			0601040- 44		1- 5	KC	40		40	8	8	8	8	8		2.2
18			0601045- 48		1- 4	KC	32		32	8	8	8	8	8		1.8
19			0221254- 57		1- 4	KC	16		16	4	4	4	4	4		0.9



									(15+3)W	(15+4)W	(19+0)W	(16+3)W	(18+1)W	(0+17)W	
39			0201538		5	KC	46	46	92				2*2*16+1W		5.1
40			0201539		5	KS	12	12	24				2*2*6/A		1.3
41			0201541		5	KS	24	24	48				2*2*12		2.7
42			0201517		3	KC	12	12	24		1*2*12				1.3
43			0221216		5	KC		28	28				1W		1.6
44			0321048		2	KC	15	15	30		1*2*15				1.7

45

of



1		18	1				
2		18	1				
3	---	18	1				
4		18	1				
5		18	1				
6		18	1				
7		18	1				
8		18	1				
9		18	1				
10		18	1				
11		18	1				
12		18	1				
13		18	1				
14		18	1				
15		18	1				
16		18	1				
17	e	18	1				
18		18	1				
19		18	1				
20		18	1				
21		18	1				
22		18	1				
23		18	1				

24		18	1			
25		18	1			
26		18	1			
27		18	1			
28		18	1			
29		18	1			
30		18	1			

				%	
				%	%
	750	532	218	19.7	8.1
	456	274	182	10.1	6.7
	770	385	385	14.3	14.3
	154	63	91	2.3	3.4
	476	0	476	0	17.6
	64	64	0	2.4	0
	<del>2698</del>	1318	1380	48.85	51.15

1

25.1

60%

40

75%

55%

2

5

6

3

24

---

4

1.

WiFi

2

4000 /

90



3				1 2 3 4
4			15	
5			16	1 2 3 4
6			65	
7				1 2 3
8				1 2 3
9		330kV	-	1 330kV 2 330kV 3 330kV

---

3

3

4

5

1

2

3

“ ”

“ ” “ + ” “ + ”

1

---

2

3

4

	4 ( 1
	1 )

1.

2

3

4


---

1

12

1	
2	
3	
4	
5	TSI
6	
7	
8	
9	
10	DCS
11	
12	



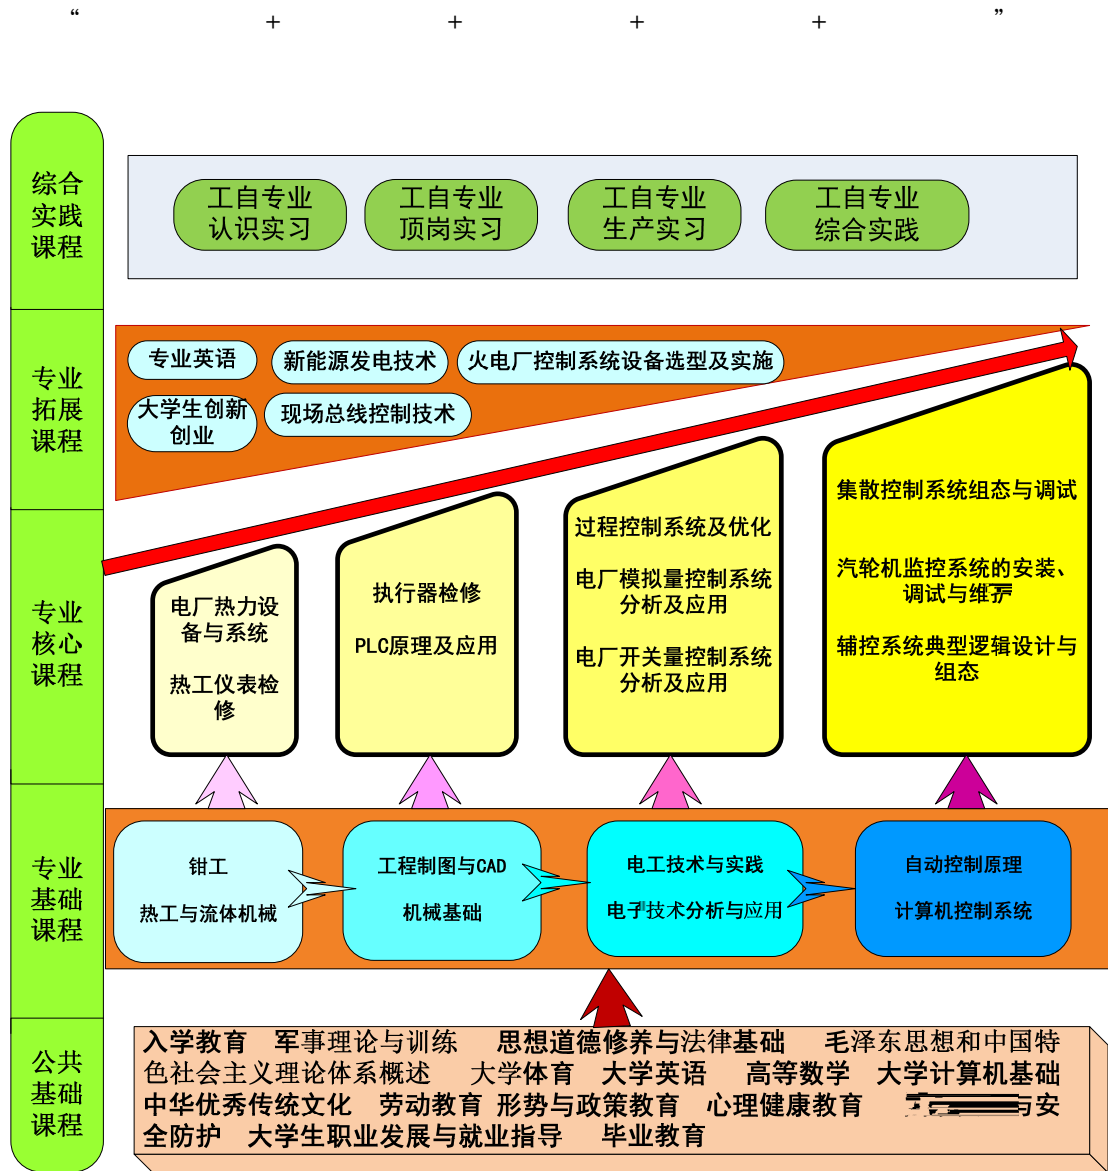



( )		